

Distribution Power Loss Mitigation of Parallel-Connected Distributed Energy Resources in Low-Voltage DC Microgrids Using A Lagrange Multiplier-Based Adaptive Droop Control

Yajie Jiang, Yun Yang, *Member, IEEE*, Siew-Chong Tan, *Senior Member, IEEE*,
and Shu-Yuen Ron Hui, *Fellow, IEEE*

Abstract—This paper presents a Lagrange multiplier-based adaptive droop control to mitigate distribution power loss of parallel-connected distributed energy resource (DER) systems in DC microgrids. The distribution power loss comprising line loss and converter loss can be modelled as a quadratic function of the output currents of the DER systems, which can be optimized by the tertiary-layer Lagrange multiplier method to obtain the optimal output current references for the secondary-layer adaptive droop control. The output currents are compensated by the adaptive droop control to provide output voltage references for the primary-layer local dual-loop control, which is a conventional local control scheme for the regulations of grid-connected DC/DC converters. Both simulation and experimental results validate that the proposed control strategy can reduce the distribution power loss of parallel-connected DER systems in 48 V DC microgrids as compared to the conventional control strategy by only optimizing the line loss in different cases.

Index Terms—Distribution power loss, distributed energy resource (DER), DC microgrid, Lagrange multiplier method, adaptive droop control.

I. INTRODUCTION

In low-voltage DC microgrids, high distribution power loss of distributed energy resources (DER) is a prominent issue that can deteriorate efficient operations of microgrid systems [1]-[6]. The distribution power loss may not only degrade power transfer efficiency of DER systems but also increase the cooling system costs [7]. To this end, pioneering researchers have investigated numerous control strategies to mitigate distribution power loss of DER systems [8]-[23].

Optimal dispatches of DER systems based on the power flow model is a widely adopted strategy to reduce the distribution power loss [8]-[11]. However, most of the dispatches are conducted offline. Alternatively, model-based optimization strategies are conducted online [12]-[23]. The distribution power loss of the model-based optimization strategies is established based on the output voltages of DER

systems and the line resistances between the DER systems and DC buses. The output voltages and power of DER systems are controlled to reduce the line loss by considering power generation limits, power flow constraints, and state-of-charge of batteries, etc. [12]-[16]. However, the converter loss, which may account over 50% of the total distribution power loss [17], has not been considered. Similar to the converter loss of DER systems in AC microgrids [18]-[21], the converter loss in DC microgrids can be calculated based on the quadratic function of the output currents as well [22]. In [17], [22] and [23], both the line loss and converter loss are taken into account as the distribution power loss of DER systems. However, these investigations are based on meshed DC microgrids and the controlled power loss is sub-optimal. The distribution power loss can be further minimized by advanced modeling and control strategies.

For DC microgrids with parallel-connected DER systems, unlike the meshed DC networks, the output currents of DER systems can be directly used to calculate both the line loss and converter loss. Since the line loss and converter loss are quadratic functions of the output currents of DER systems, the distribution power loss of the parallel-connected DER systems is also a quadratic function of the output currents of DER systems, which can be proved as a convex function. Besides, by considering the current balance between the power supply and demand, the distribution power loss model can be further extended to be an equality-constrained convex function with respect to the current allocation coefficients of DER systems. Consequently, the distribution power loss can be reduced by optimizing the current allocation coefficients.

In this paper, a Lagrange multiplier-based adaptive droop control is proposed to reduce both the line loss and the converter loss of parallel-connected DER systems in DC microgrids. The proposed control is a three-layer hierarchical control that comprises a Lagrange multiplier method in the tertiary layer, an adaptive droop control in the secondary layer, and the conventional local dual-loop control in the primary layer. The Lagrange multiplier method of the tertiary layer is designed to provide the optimal current allocation coefficients for the adaptive droop control of the secondary layer by optimizing the distribution power loss model with equal constraints [24]. Based on the optimal current allocation coefficients and the total output current of the DER systems, the output current references of the DER systems can be calculated and tracked by the adaptive droop control to provide output voltage references of the DER systems for the local dual-loop control. Then, the duty ratios of the driving

Manuscript received September 08, 2020; revised December 01, 2020; accepted January 03, 2021. (*Corresponding author: Yun Yang*).

Y. Jiang, and S.C. Tan, are with the Department of Electrical and Electronic Engineering, The University of Hong Kong, Hong Kong. (email: yjjiang@eee.hku.hk; sctan@eee.hku.hk).

Y. Yang is with the Department of Electrical Engineering, The Hong Kong Polytechnic University, Hong Kong. (email: yun1989.yang@polyu.edu.hk).

S.Y. Ron Hui is with the Department of Electrical and Electronic Engineering, The University of Hong Kong, Hong Kong, and also with the Department of Electrical and Electronic Engineering, Imperial College London, London SW7 2AZ, U.K. (email: ronhui@eee.hku.hk).

signals for the grid-connected converters are derived by the local dual-loop control based on the output voltage references. Obviously, the proposed control strategy is an online control scheme that can mitigate the distribution power loss of the DER systems in DC microgrids, while simultaneously regulating the output voltages and power within the tolerances. However, the proposed control scheme is only designed for parallel-connected DER systems. For distributed DC microgrids with meshed networks, further investigations are needed.

II. DISTRIBUTION POWER LOSS MODELLING OF DER

The simplified architecture of a typical DC microgrid, which mainly comprises DER systems and loads, is shown in Fig. 1. The DER systems and loads are connected in parallel to the DC bus. In this paper, DER refer to those dispatchable units that the power interactions between the units and microgrids can be regulated via grid-connected converters, such as energy storage systems (ESS), fuel cells, and gas turbines, etc. Non-dispatchable units, such as photo-voltaic (PV) systems and wind energy conversion systems, are not considered as DER. Instead, they are be modelled as current sources [25]. The loads in DC microgrids may include constant power loads (CPL), constant resistive loads (CRL), nonlinear loads, variable loads, and pulse loads. Most loads require grid-connected converters to regulate the output power, voltage, or current. For instance, the output power of a motor driving system needs to be controlled at the rated power. However, some resistive loads, such as water heaters, can be directly connected to the DC microgrid without using grid-connected converters.


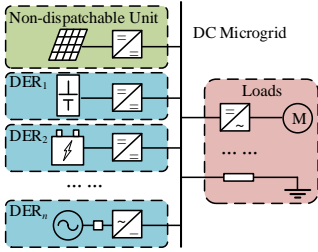


Fig. 1. A typical DC microgrid with n parallel-connected DER.

Fig. 2. The circuit diagram of DC microgrid.

According to the simplified architecture in Fig. 1, the circuit diagram of a DC microgrid with n DERs can be depicted in Fig. 2. Here, V_{bus} is the DC bus voltage. V_i and I_i ($i=1, 2, \dots, n$) are the output voltages and currents of DER. $I_i > 0$ indicates the current flowing from the i -th DER to the DC bus and $I_i < 0$ indicates the current flowing from the DC bus to the i -th DER. R_i ($i=1, 2, \dots, n$) are the distribution line resistances.

The distribution power loss of the DER includes the converter loss (i.e., P_{loss}^{conv}) of the grid-connected converters and the line loss (i.e., P_{loss}^{line}) on the distribution cables. The converter loss of the i -th DER mainly comprises the average conduction loss of switches (i.e., P_{conSi}), average conduction loss of bypass diodes (i.e., P_{conDi}), average switching loss (i.e.,

P_{swi}), average reverse recovery loss of bypass diodes (i.e., P_{reci}), and power loss on resistive elements (i.e., P_{resi}) as

$$P_{lossi}^{conv} = P_{conSi} + P_{conDi} + P_{swi} + P_{reci} + P_{resi} \quad (1.1)$$

The power loss on the parasitic parameters and auxiliary circuits are generally negligible as compared to these power losses for the grid-connected converters in DER. In a system-level analysis of the grid-connected converters, based to the analysis in [17]-[22], [26], [27], the converter loss of the i -th DER can be simplified as a quadratic function of the output currents of DER as

$$P_{lossi}^{conv} = a_i I_i^2 + b_i |I_i| + c_i \quad (1.2)$$

where $a_i > 0$, $b_i > 0$, and $c_i > 0$ are the conversion loss coefficients of the grid-connected converter of i -th DER, which can be determined by identification methods (i.e., least square method, heuristic algorithm, and neural networks, etc.) based on practical measurements [17], [18]. Besides, the line loss of the i -th DER can be calculated based on

$$P_{lossi}^{line} = R_i I_i^2 \quad (2)$$

Based on (1.2) and (2), the distribution power loss of the i -th DER can be given as

$$P_{lossi} = P_{lossi}^{conv} + P_{lossi}^{line} = (a_i + R_i) I_i^2 + b_i |I_i| + c_i \quad (3.1)$$

By defining the total output current of DER and the current allocation coefficient of the i -th DER as I_{tol} and N_i , respectively, the distribution power loss of the i -th DER can be further derived as

$$P_{lossi} = (a_i + R_i) (N_i I_{tol})^2 + b_i |N_i I_{tol}| + c_i \quad (3.2)$$

Here, the total output current and the current allocation coefficient should satisfy

$$\sum_{i=1}^n N_i = 1 \quad (3.3)$$

$$\sum_{i=1}^n I_i = I_{tol} \quad (3.4)$$

By defining $g(N_i) = \sum_{i=1}^n N_i - 1$, the constraint of the current allocation coefficient can be provided as

$$g(N_i) = 0 \quad (3.5)$$

The total distribution power loss of all DER in the DC microgrid can be derived based on (3.2), as

$$P_{loss}(N_i) = \sum_{i=1}^n P_{lossi} = \sum_{i=1}^n (a_i + R_i) (N_i I_{tol})^2 + b_i |N_i I_{tol}| + c_i \quad (4)$$

According to (4), the total distribution power loss of DER can be regulated by current allocation coefficients N_i ($i=1, 2, \dots, n$).

By taking the first- and second-order partial derivatives of (4) with respect to N_i gives

$$\frac{\partial P_{loss}(N_i)}{\partial N_i} = 2N_i (a_i + R_i) (I_{tol})^2 + b_i |I_{tol}| \quad (5.1)$$

$$\frac{\partial^2 P_{loss}(N_i)}{\partial N_i^2} = 2(a_i + R_i) (I_{tol})^2 \quad (5.2)$$

Apparently, the first-order partial derivative of the power loss model is continuous and differentiable, and the Hessian of the

power loss model is positive semidefinite for all N_i , which means the power loss model in (4) is strictly convex. Then, the distribution power loss of DER in the DC microgrid can be implemented by minimizing the power loss model with considerations of the equal constraint as

$$\begin{aligned} \min \quad & J = P_{\text{loss}}(N_i) \\ \text{s.t.} \quad & g(N_i) = 0 \end{aligned} \quad (6)$$

Compared to the objective function of the proposed method in (6), the objective function of the conventional method only comprises the line loss in (2). The analysis in [12], [17] and [22] reveal that the output voltages of the DER systems are required to be controlled in consensus (i.e., $V_1 = V_2 = \dots = V_n$) by the conventional control to minimize the total line loss of the DER systems.

III. PROPOSED CONTROL STRATEGY

The proposed control strategy consists of a Lagrange multiplier method to optimize the cost function in (6) and an adaptive droop control to regulate the output voltages of DER. A communication network is required to transfer data from the local sensors to the central controller to ensure the robustness of control in circumstances of plug-in and plug-off of DER systems, fluctuations of power sources and load variations, and some parameter variations, etc. The flowchart of the control algorithm is depicted in Fig. 3. Optimal current allocation coefficients are provided by the Lagrange multiplier method to obtain the output voltage references of DER by the adaptive droop control. The output voltage references are further tracked by the conventional dual-loop control to regulate the duty ratios of the grid-connected converters. The output power of DER are strictly controlled within the tolerances by the Lagrange multiplier method as

$$P_{\min i} \leq P_i \leq P_{\max i} \quad (7.1)$$

where P_i is the output power of the i -th DER. $P_{\min i}$ and $P_{\max i}$ are lower and upper bounds of the output power of the i -th DER. Besides, the output voltages of DER are guaranteed to be controlled within the tolerances by the adaptive droop control as

$$V_{\min i} \leq V_i \leq V_{\max i} \quad (7.2)$$

where $V_{\min i}$ and $V_{\max i}$ are lower and upper bounds of the output voltage of the i -th DER.

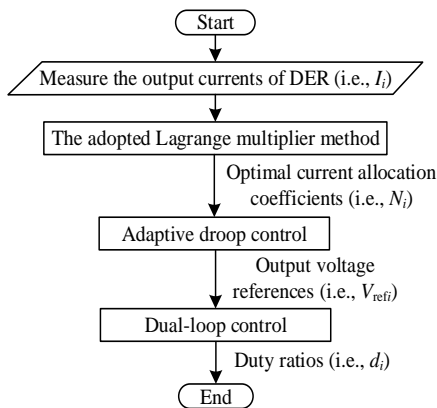


Fig. 3. Flowchart of the proposed control algorithm.

A. The Adopted Lagrange Multiplier Method

Based on the cost function in (6), the Lagrange function of the Lagrange multiplier method can be defined as

$$\begin{aligned} L(N_i, \lambda) &= P_{\text{loss}}(N_i) + \lambda \cdot g(N_i) \\ &= \sum_{i=1}^n [(a_i + R_i)(N_i I_{\text{tol}})^2 + b_i N_i |I_{\text{tol}}| + c_i] + \lambda (\sum_{i=1}^n N_i - 1) \end{aligned} \quad (8)$$

where the Lagrange multiplier is nonzero (i.e., $\lambda \neq 0$). The optimal current allocation coefficients (i.e., N_i) can be derived by equating the first-order partial derivative of the Lagrange function to zero, as

$$\nabla_{N_i, \lambda} L(N_i, \lambda) = \left(\frac{\partial L}{\partial N_i}, \frac{\partial L}{\partial \lambda} \right) = 0 \quad (9)$$

which yields

$$N_i = -\frac{b_i |I_{\text{tol}}| + \lambda}{2(a_i + R_i)(I_{\text{tol}})^2} \quad (10.1)$$

$$\lambda = -\frac{\sum_{i=1}^n \frac{b_i}{2(a_i + R_i)|I_{\text{tol}}|} + 1}{\sum_{i=1}^n \frac{1}{2(a_i + R_i)(I_{\text{tol}})^2}} \quad (10.2)$$

However, the derived N_i in (10.1) may not be eventually adopted, since the output power of some DER with the derived N_i in (10.1) may violate the constraint in (7.1). Therefore, maximum and minimum output power of DER (i.e., $P_{i_{\max}}$ and $P_{i_{\min}}$) are required to be further determined. The output power of each DER can be estimated by adding the distribution power loss and the injected power from each DER to the DC bus (i.e., $P_i = P_{\text{loss}i} + P_{\text{s}2\text{b}i}$). Based on (10.1) and the total output current of DER, the output current of each DER can be calculated using $|I_i| = |N_i I_{\text{tol}}|$. Then, the distribution power loss of each DER can be obtained based on (3.1). Besides, the injected power from each DER to the DC bus can be calculated by multiplying the DC bus voltage and the output current of each DER (i.e., $P_{\text{s}2\text{b}i} = V_{\text{bus}} |I_i|$). As the DC bus voltage can be controlled within the tolerances in (7.2), the maximum and minimum injected power are $P_{\text{s}2\text{b}i_{\max}} = V_{\max i} |I_i|$ and $P_{\text{s}2\text{b}i_{\min}} = V_{\min i} |I_i|$, respectively. Hence, the maximum and minimum output power of each DER can be calculated by $P_{i_{\max}} = P_{\text{loss}i} + P_{\text{s}2\text{b}i_{\max}}$ and $P_{i_{\min}} = P_{\text{loss}i} + P_{\text{s}2\text{b}i_{\min}}$, respectively. If the maximum output power of the DER is larger than the upper bound (i.e., $P_{i_{\max}} > P_{\max i}$), the output power of the DER is required to be regulated at the upper bound by controlling the output current of the DER as

$$|I_{\max i}| = \frac{\sqrt{(b_i + V_{\max i})^2 + 4(a_i + R_i)(P_{\max i} - c_i)}}{2(a_i + R_i)} \quad (11.1)$$

Conversely, if the minimum output power of the DER is smaller than the lower bound (i.e., $P_{i_{\min}} > P_{\min i}$), the output power of the DER is required to be regulated at the lower bound by controlling the output current of the DER as

$$|I_{\min i}| = \frac{\sqrt{(b_i + V_{\min i})^2 + 4(a_i + R_i)(P_{\min i} - c_i)}}{2(a_i + R_i)} \quad (11.2)$$

When the output power of the i -th DER is regulated at the upper bound (or the lower bound), the total output current of the remaining DER is $|I'_{\text{tol}}| = |I_{\text{tol}}| - |I_{\max i}|$ (or $|I'_{\text{tol}}| = |I_{\text{tol}}| - |I_{\min i}|$). According to (5.1) and (5.2), the distribution power loss function of the remaining DER systems still remains convex. Thus, by combing (10.1), (11.1), and (11.2), the optimal current allocation coefficients derived by the adopted Lagrange multiplier method can be given as

$$N_i = \begin{cases} \frac{|I_{\max i}|}{|I_{\text{tol}}|} & P_i > P_{\max i} \\ \frac{|I_{\min i}|}{|I_{\text{tol}}|} & P_i < P_{\min i} \\ -\frac{b_i |I_{\text{tol}}| + \lambda}{2(a_i + R_i)(I_{\text{tol}})^2} & P_{\min i} \leq P_i \leq P_{\max i} \end{cases} \quad (12)$$

B. Adaptive Droop Control

The adaptive droop control is designed to track the output currents of DER accurately even if the power conditions of the system change (e.g., plug in/off of RES systems, fluctuations of power sources and load variations). The control block diagram of the adaptive droop control is shown in Fig. 4. The adaptive droop control provides the output voltage references of DER (i.e., $V_{\text{ref}i}$) for the conventional dual-loop control.

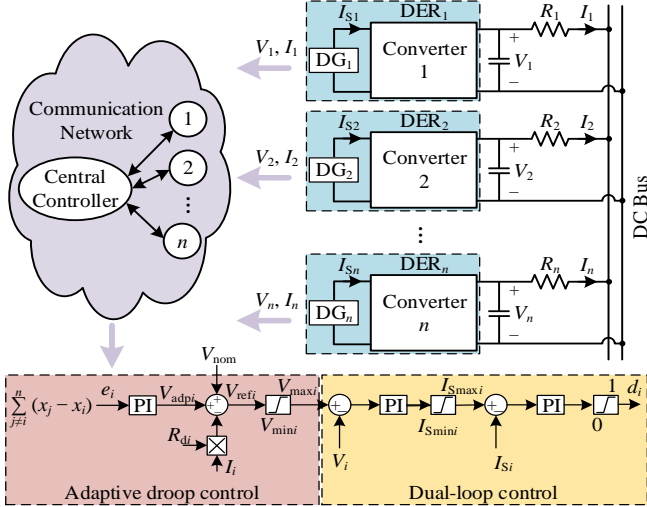


Fig. 4. Schematic diagram of the adaptive droop control and dual-loop control.

The control variables of the adaptive droop control are defined as $x_i = \frac{I_i}{N_i}$, where I_i are measured by current sensors and N_i are provided by the Lagrange multiplier method based on (12). Then, the total current allocation errors of the system can be written as

$$e_i = \sum_{i=1, j \neq i}^n (x_j - x_i) \quad (13)$$

which needs to be controlled at zero such that the control variables (i.e., x_i) are equalized for all the DER system as

$$\frac{I_1}{N_1} = \frac{I_2}{N_2} = \dots = \frac{I_n}{N_n} \quad (14)$$

The total current allocation errors are compensated by conventional proportional-integral (PI) controllers to derive adaptive voltage terms (i.e., $V_{\text{adp}i}$) for the output voltage references of DER systems, as

$$V_{\text{adp}i} = (k_{p_i} + \frac{k_{i_i}}{s})e_i \quad (15)$$

where k_{p_i} and k_{i_i} are the proportional and integral gains of the i -th PI controller (i.e., $k_{p_i} > 0$ and $k_{i_i} > 0$). By substituting (13) into (15),

$$V_{\text{adp}i} = k_{p_i} \sum_{i=1, j \neq i}^n (x_j - x_i) + \frac{k_{i_i}}{s} \sum_{i=1, j \neq i}^n (x_j - x_i) \quad (16)$$

Then, the output voltage references (i.e., $V_{\text{ref}i}$) can be provided by the droop control as

$$V_{\text{ref}i} = V_{\text{nom}} - R_{di} I_i + V_{\text{adp}i} \quad (17)$$

where V_{nom} is the nominal DC bus voltage and R_{di} is the droop coefficient of the i -th DER. A voltage limiter is adopted in the droop control to ensure the output voltage references are within the tolerances, as given in (7.2). According to (16) and (17), when the control variable of the i -th DER (i.e., x_i) is increased, the output voltage reference of the i -th DER (i.e., $V_{\text{ref}i}$) will be decreased. Consequently, the output current of the i -th DER (i.e., I_i) will decrease such that the control variable of the i -th DER (i.e., x_i) will decrease. Conversely, when the control variable of the i -th DER (i.e., x_i) is decreased, the output voltage reference of the i -th DER (i.e., $V_{\text{ref}i}$) will be increased. As a result, the output current of the i -th DER (i.e., I_i) will increase such that the control variable of the i -th DER (i.e., x_i) will increase. Obviously, the adopted adaptive droop control can effectively regulate the total current allocation errors to be zero. The robustness of the adopted adaptive droop control is better than that of the conventional adaptive droop control by introducing the adaptive voltage term $V_{\text{adp}i}$.

Based on (16), the Laplace transformation of the adaptive voltages for all DER can be derived as

$$s \mathbf{V}_{\text{adp}}(s) = \mathbf{G}(s)(\mathbf{E} - n\mathbf{I})\mathbf{x}(s) = s \mathbf{k}_p (\mathbf{E} - n\mathbf{I})\mathbf{x}(s) + \mathbf{k}_i (\mathbf{E} - n\mathbf{I})\mathbf{x}(s) \quad (18)$$

where $\mathbf{V}_{\text{adp}}(s) = [V_{\text{adp}1}(s), \dots, V_{\text{adp}n}(s)]^T$, $\mathbf{x}(s) = [x_1(s), \dots, x_n(s)]^T$, $\mathbf{G}(s) = \text{diag}\{sk_{p1} + k_{i1}, \dots, sk_{pn} + k_{in}\}$, $\mathbf{k}_p = \text{diag}\{k_{p1}, \dots, k_{pn}\}$, $\mathbf{k}_i = \text{diag}\{k_{i1}, \dots, k_{in}\}$, \mathbf{I} is an $n \times n$ identity matrix and \mathbf{E} is an $n \times n$ matrix with all the elements being one. When the system reaches the steady state (i.e., $t \rightarrow \infty$), based on the final value theorem (i.e., $s=0$),

$$\lim_{s \rightarrow 0} (\mathbf{E} - n\mathbf{I})\mathbf{x}(s) = 0 \quad (19)$$

By rewriting (19),

$$\left[\sum_{i=1}^n (x_i - x_1) \quad \sum_{i=1}^n (x_i - x_2) \quad \dots \quad \sum_{i=1}^n (x_i - x_n) \right]^T = [0 \quad 0 \quad \dots \quad 0]^T \quad (20)$$

According to the **Theorem 1** in the Appendix, the control variables (i.e., x_1, x_2, \dots, x_n) are converged to a consensus at steady state as

$$x_1 = x_2 = \dots = x_n \quad (21)$$

It is worth noting that the convergence of the control variables can still hold by even considering communication delays in the emerging DC microgrids with relatively short geographical distances and advanced communication technology [28].

According to the analysis in [29, 30], the adaptive voltage term (i.e., V_{adpi}) in the time domain (i.e., $v_{\text{adpi}}(t)$) can be further derived by considering the non-negligible communication delay as

$$v_{\text{adpi}}(t) = k_{\text{pi}} \sum_{i=1, j \neq i}^n [x_j(t - \tau_j) - x_i(t)] + k_{\text{li}} \int \sum_{i=1, j \neq i}^n [x_j(t - \tau_j) - x_i(t)] dt \quad (22)$$

Because the state variables are generally invariant during the communication delay period, by taking the derivatives on both sides of (22),

$$\dot{v}_{\text{adpi}}(t) = k_{\text{li}} \sum_{i=1, j \neq i}^n [x_j(t - \tau_j) - x_i(t)] \quad (23)$$

where τ_j denotes the communication delay between the node j and the node i . Here, the state variables satisfy

$$x_i(t) = G_i v_{\text{adpi}}(t) \quad (24)$$

where the line admittance G_i is generally constant during the communication delay period and $G_i > 0$. Besides, by defining the error between each state variable and the reference as

$$\varepsilon_i(t) = x_i(t) - x_{\text{ref}} \quad (25)$$

the dynamics can be further derived by substituting (24) into (25) as

$$\dot{\varepsilon}_i(t) = G_i \dot{v}_{\text{adpi}}(t) \quad (26)$$

By substituting (23) into (26) to eliminate the term $\dot{v}_{\text{adpi}}(t)$,

$$\dot{\varepsilon}_i(t) = G_i k_{\text{li}} \sum_{i=1, j \neq i}^n [x_j(t - \tau_j) - x_i(t)] \quad (27)$$

According to (25) and (27), the candidate Lyapunov-Krasovskii function can be designed as [30]

$$V(t) = \sum_{i=1}^n [\varepsilon_i(t)]^2 + \sum_{i=1}^n \sum_{j \neq i} G_i k_{\text{li}} \int_{t-\tau_j}^t [\varepsilon_j(\sigma)]^2 d\sigma \quad (28)$$

It is obvious that $V(t) \geq 0$ can always hold. Based on (28), the derivative of the Lyapunov-Krasovskii function can be derived as

$$\dot{V}(t) = 2 \sum_{i=1}^n \varepsilon_i(t) \dot{\varepsilon}_i(t) + \sum_{i=1}^n \sum_{j \neq i} G_i k_{\text{li}} \{ [\varepsilon_j(t)]^2 - [\varepsilon_j(t - \tau_j)]^2 \} \quad (29)$$

By substituting (27) into (29) to eliminate the term $\dot{\varepsilon}_i(t)$,

$$\begin{aligned} \dot{V}(t) = & 2 \sum_{i=1}^n \sum_{j \neq i} G_i k_{\text{li}} \varepsilon_i(t) [\varepsilon_j(t - \tau_j) - \varepsilon_i(t)] \\ & + \sum_{i=1}^n \sum_{j \neq i} G_i k_{\text{li}} \{ [\varepsilon_j(t)]^2 - [\varepsilon_j(t - \tau_j)]^2 \} \end{aligned} \quad (30)$$

Since the communication graph of the adopted communication graph is naturally balanced,

$$\sum_{i=1}^n \sum_{j \neq i} \varepsilon_i(t)^2 = \sum_{i=1}^n \sum_{j \neq i} \varepsilon_j(t)^2 \quad (31)$$

By substituting (31) into (30) to eliminate the term $\sum_{i=1}^n \sum_{j \neq i} \varepsilon_j(t)^2$,

$$\dot{V}(t) = - \sum_{i=1}^n \sum_{j \neq i} G_i k_{\text{li}} [\varepsilon_i(t) - \varepsilon_j(t - \tau_j)]^2 \quad (32)$$

Obviously, the Lyapunov stability is guaranteed (i.e., $\dot{V}(t) \leq 0$). The Lyapunov-Krasovskii function (i.e., $V(t)$) converges to zero asymptotically. Accordingly, the state variables (i.e., $x_i(t)$) can converge to the reference (i.e., x_{ref}) asymptotically. Therefore, the proposed control strategy is validated to achieve proportional current allocations even with the considerations of non-negligible communication delays.

The derived output voltage references by the adaptive droop control are further tracked by the dual-loop control to regulate the grid-connected converters. The source currents (i.e., I_{Si}) and the duty ratios of grid-connected converters (i.e., d_i) are strictly controlled within the tolerances (i.e., $I_{\text{Smin}i} \leq I_{\text{Si}} \leq I_{\text{Smax}i}$ and $0 \leq d_i \leq 1$) by PI controllers. It is worth noting that the proposed control strategy is also validated for the grid-connected converters with other types of local control (e.g., one-loop voltage control).

IV. SIMULATION RESULTS

Simulation-based case studies are carried out in Matlab/Simulink based on a 48 V DC microgrid with four DER systems being connected in parallel to a DC bus. The circuitry of the DC microgrid in simulation is depicted in Fig. 5. Non-isolated boost converters are adopted as the grid-connected converters for the DER systems. Without losing the generality, non-dispatchable units and loads are modelled as a current sink, the current of which equals to the total output current of the DER systems to ensure the current balance in the DC microgrid. Hence, the current sink is positive when the total output current of the DER systems is negative. Conversely, the current sink is negative when the total output current of the DER systems is positive. The main specifications of the DC microgrid are listed in Table I. The parameters of the four DER systems are identical (i.e., $L_1=L_2=L_3=L_4$, $C_1=C_2=C_3=C_4$, and $R_{L1}=R_{L2}=R_{L3}=R_{L4}$, etc.), while the line resistances of the four DER systems are different. It should be noted that the DER systems with different time constants will not affect the control performance since the operating frequency of the local dual-loop control is much faster than that of the higher-layer control [31], [32]. The DC bus voltage is allowed to deviate within 5% (i.e., $V_{\text{min}}=45.6$ V and $V_{\text{max}}=50.4$ V). The rated, minimum, and maximum power of the four DER systems are 300 W, 0 W, and 350 W, respectively (i.e., $P_{\text{min}}=0$ W and $P_{\text{max}}=350$ W). The switching frequency of the grid-connected converters is 100 kHz. The communication delay is set to be 0.01s.

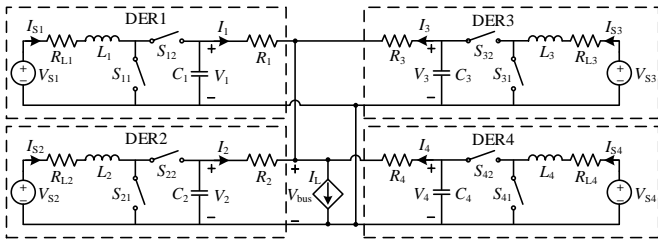


Fig. 5. Circuitry of the DC microgrid with four parallel-connected DER systems in simulation.

TABLE I. MAIN SPECIFICATIONS OF DC MICROGRID IN SIMULATION

Descriptions	Symbol	Value
Nominal DC bus voltage	V_{bus_nom}	48 V
Lower limit of the DC bus voltage	V_{min}	45.6 V
Upper limit of the DC bus voltage	V_{max}	50.4 V
Rated power of the DER systems	P_{rate}	300 W
Lower power limit of the DER systems	P_{min}	0 W
Upper power limit of the DER systems	P_{max}	350 W
Rate voltages of the distributed generations	V_{Si_rated}	24 V
Inductances of the converter	L_i	460 μ H
ESR of the inductances	R_{L_i}	0.1 Ω
Output capacitances of the converter	C_i	10.1 μ F
Forward voltages of the bypass diodes	V_{Di}	0.3 V
Output capacitances of the switches	C_{si}	102 pF
ON resistances of the switches	R_{si}	72 m Ω
Line resistance of DER1	R_1	0.5 Ω
Line resistance of DER2	R_2	0.8 Ω
Line resistance of DER3	R_3	0.2 Ω
Line resistance of DER4	R_4	1.1 Ω

The parameters of the controllers in simulation are provided in Table II. The parameters of the PI compensators in both the adaptive droop control and the conventional dual-loop control are identical for all the four DER (i.e., $K_{P1}=K_{P2}=K_{P3}=K_{P4}$, $K_{I1}=K_{I2}=K_{I3}=K_{I4}$, $K_{P11}=K_{P12}=K_{P13}=K_{P14}$, $K_{I11}=K_{I12}=K_{I13}=K_{I14}$, $K_{P21}=K_{P22}=K_{P23}=K_{P24}$, and $K_{I21}=K_{I22}=K_{I23}=K_{I24}$). The droop coefficients of the adaptive droop control are also the same for all the four DER (i.e., $R_{d1}=R_{d2}=R_{d3}=R_{d4}$). The sampling frequency of the controllers is 100 kHz.

TABLE II. PARAMETERS OF CONTROLLERS IN SIMULATION

Descriptions	Symbol	Value
Proportional gain of the PI compensation in the adaptive droop control	K_{Pi}	0.02
Integral gain of the PI compensation in the adaptive droop control	K_{Ii}	1
Proportional gain of the PI voltage compensation in the dual-loop control	K_{P1i}	20
Integral gain of the PI voltage compensation in the dual-loop control	K_{I1i}	10
Proportional gain of the current PI current compensation in the dual-loop control	K_{P2i}	100
Integral gain of the PI current compensation in the dual-loop control	K_{I2i}	20
Lower bound of the output voltage of DER	V_{mini}	45.6 V
Upper bound of the output voltage of DER	V_{maxi}	50.4 V
Lower bound of the source current of DER	I_{Smini}	0 A
Upper bound of the source current of DER	I_{Smaxi}	15 A
Droop coefficient	R_{di}	0.05 Ω
Converter loss coefficients of DER1	a	1.166
	b	2.410
	c	1.110

Converter loss coefficients of DER2	a	0.176
	b	1.040
	c	2.040
Converter loss coefficients of DER3	a	0.477
	b	0.956
	c	1.360
Converter loss coefficients of DER4	a	0.730
	b	1.600
	c	0.600

A. Convexity of the Distribution Power Loss Model

The convexity of the derived distribution power loss model in (4) is initially verified by the simulation. For the DC microgrid with two DER (i.e., DER1 and DER2, DER1 and DER3, DER1 and DER4, DER2 and DER3, DER2 and DER4, DER3 and DER4), the distribution power loss of the DER systems (i.e., P_{loss}) versus different values of current allocation coefficients (i.e., N_1 , N_2 , and N_3) are plotted in Fig. 6. The sum of the current allocation coefficients for each case is 1. Apparently, the distribution power loss curve is convex with only one minimum point regardless of different total output currents of the DER systems (i.e., $I_{tol}=12$ A, $I_{tol}=16$ A, and $I_{tol}=20$ A). The coordinates of the minimum points are labeled in Fig. 6.

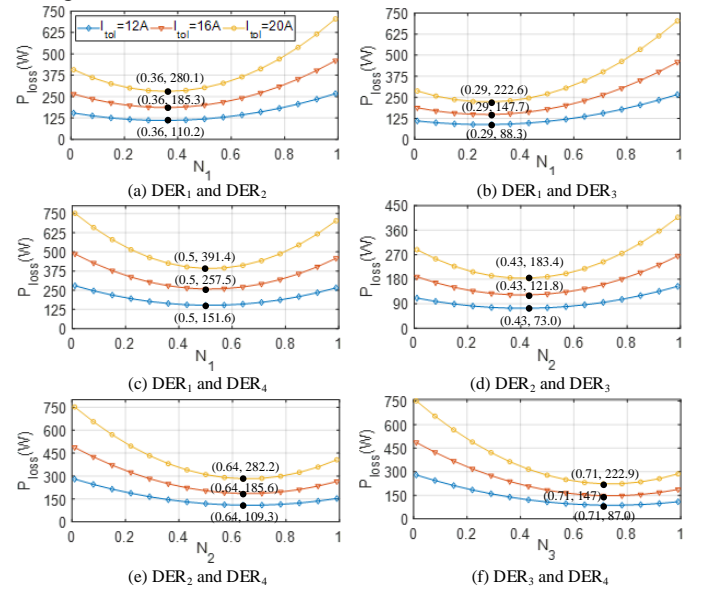


Fig. 6. Distribution power loss versus current allocation coefficients for the DC microgrid with two DER systems.

For the DC microgrid with three DER (i.e., DER1, DER2 and DER3, DER1, DER 2 and DER4, DER2, DER3 and DER4), the distribution power loss of the DER systems versus different values of current allocation coefficients are plotted in Fig. 7. The total output current of the three DER systems is 16 A and the sum of the current allocation coefficients for each case is 1. Obviously, the distribution power loss surfaces are convex with only one minimum point in each case. The minimum distribution power loss are 107.5 W, 146.4 W, 123.2 W, and 106 W, respectively.

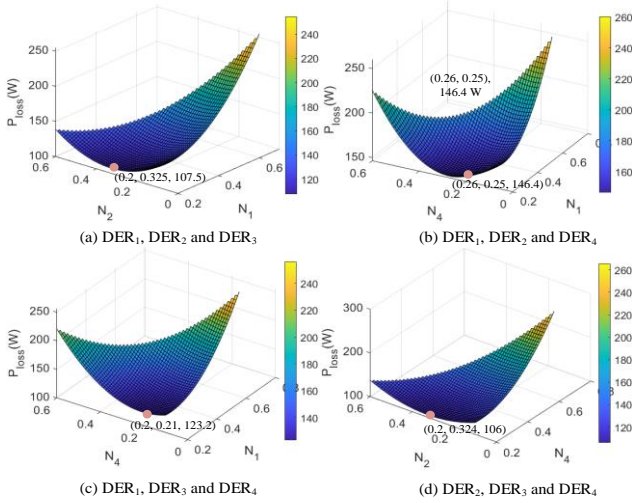


Fig. 7. Distribution power loss versus current allocation coefficients for the DC microgrid with three DER systems.

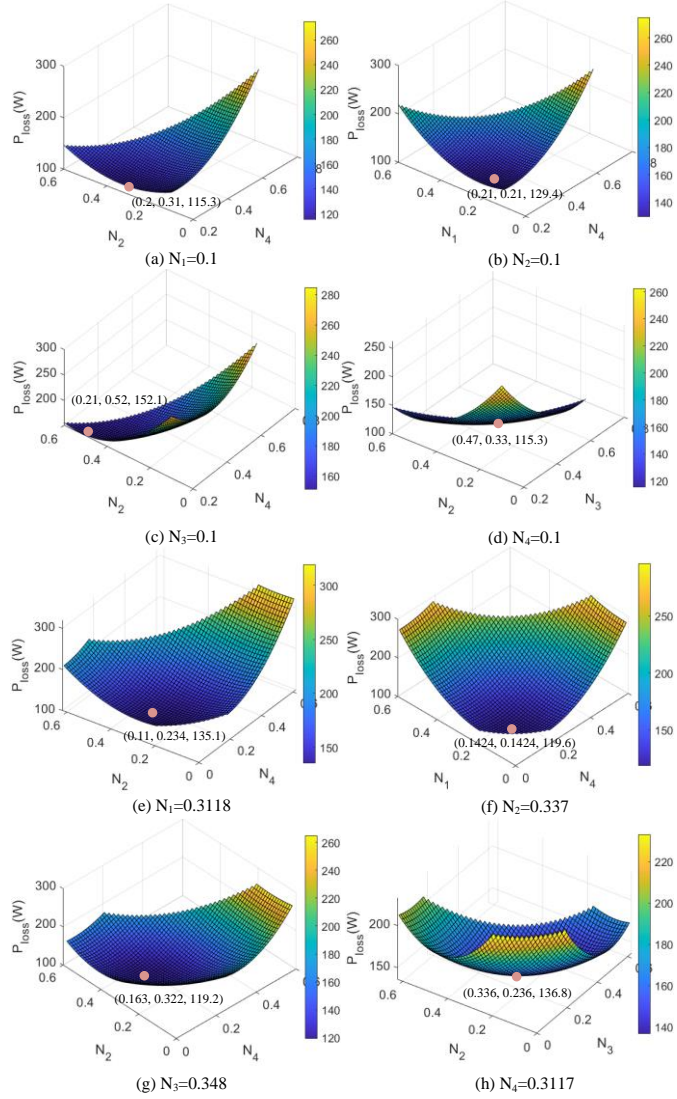


Fig. 8. Distribution power loss versus current allocation coefficients for the DC microgrid with four DER systems.

Similarly, the distribution power loss of the DER systems versus different values of current allocation coefficients in a DC microgrid with four DER are presented in Fig. 8. The total output current of the four DER systems is 16 A and the sum of the current allocation coefficients is 1. In Figs. 8(a)~(d), one current allocation coefficient is fixed at 0.1, such that the constraint in (7.1) is not violated. Apparently, the distribution power loss surfaces are convex and the minimum power loss are 115.3 W, 129.4 W, 152.1 W, and 115.3 W, respectively. In Figs. 8(e)~(h), the current allocation coefficients are fixed at 0.3118, 0.337, 0.348, and 0.3117, respectively (i.e., $N_1=0.3118$ in Fig. 8(e), $N_2=0.337$ in Fig. 8(f), $N_3=0.348$ in Fig. 8(g), and $N_4=0.3117$ in Fig. 8(h)), such that the output power of DER are limited at the maximum power. Nevertheless, the distribution power loss surfaces are still convex, which is in good agreement with theoretical analysis. The minimum power loss are 135.1 W, 119.6 W, 119.2 W, and 136.8 W, respectively. For the output power of DER are limited at the minimum power, one current allocation coefficient is fixed at 0. Therefore, the distribution power loss surfaces are the same as the power loss surfaces of the DC microgrid with three DER in Fig. 7. The surfaces are also verified to be convex.

B. Validation of the Proposed Control Strategy

In simulation, three cases are investigated to verify the effectiveness of the proposed control strategy to mitigate more distribution power loss than the conventional control strategy for the DC microgrid with four DER systems. Details of the three case studies are provided in Table III. In case 1, the output power of DER systems (i.e., P) being controlled by the proposed control strategy are within the boundaries. The output power of the DER system is positive when it flows from the DER system to the DC bus, as presented in case 1.1. Conversely, the output power of the DER system is negative when it flows from the DC bus to the DER system, as presented in case 1.2. In case 2, the output powers of one DER system controlled by the conventional control strategy and the proposed control strategy without considering the power constraint in (7.1) are beyond the power limit. But the output power of the DER system controlled by the proposed control strategy with the power constraint is clamped at the boundary. In case 3, other than the four DER systems, three and five DER systems controlled by the conventional control strategy and the proposed control strategy are also investigated. In case 4, a daylong variable power supply by a non-dispatchable unit and a power demand by the loads are adopted for the DC microgrid with four DER systems.

TABLE III. DETAILS OF THE CASE STUDIES IN SIMULATION

Case	Descriptions	
1	1.1	Output power of DER systems are within the bounds
	1.2	
2	Output power of one DER system is clamped at the boundary	
3	Different numbers of DER systems in the DC microgrid	
4	Practical power supply and demand of DER systems in a day	

Fig. 9 shows the waveforms of the current allocation coefficients, Lagrange multiplier, output voltages and power of the DER systems, bus voltage, and distribution power loss of the DC microgrid controlled by the conventional control

strategy and the proposed control strategy for case 1.1. The total output current of the DER systems is 13 A and the current sink is modelled to be 13 A. The conventional control strategy is adopted to reduce the line loss of the DER systems during the period from 0s to 2s whereas the proposed control strategy is adopted to mitigate the distribution power loss of the DER systems during the period from 2s to 8s. For the conventional control strategy, since the Lagrange multiplier method is not included, the Lagrange multiplier (i.e., λ) is 0. The output voltages of the DER systems are converged at 48 V and the bus voltage is at 46.25 V. The output power of the DER3 is 419 W, which is beyond the upper limit of 350 W. The line loss is minimized at 29 W, while the conversion loss and total distribution power loss are 80 W and 109 W, respectively. However, for the proposed control strategy, the Lagrange multiplier is calculated to be -162.4 and the current allocation coefficients are controlled at $N_1=0.144$, $N_2=0.2896$, $N_3=0.4214$, and $N_4=0.1449$, respectively. As a result, the output voltages and power of the DER systems are within the boundaries. Compared to the conventional control strategy, the line loss of the proposed control strategy is increased (i.e., 34.9 W > 29W), the total distribution power loss is mitigated (i.e., 96.1 W < 109 W) since the conversion loss is significantly reduced from 80 W to 61.2 W. The total distribution power loss is reduced by about 11.83%. To validate the effectiveness of the proposed control with non-negligible communication delay, the communication delay is changed from 0.01s to 0.05s and 0.1s. The corresponding waveforms of the distribution power loss are plotted in Fig. 10. Apparently, the existence of non-negligible communication delay will not affect the reduced power loss at steady states. Although the dynamic performances are deteriorated, the power curves can eventually converge asymptotically, which validates the aforementioned analysis.

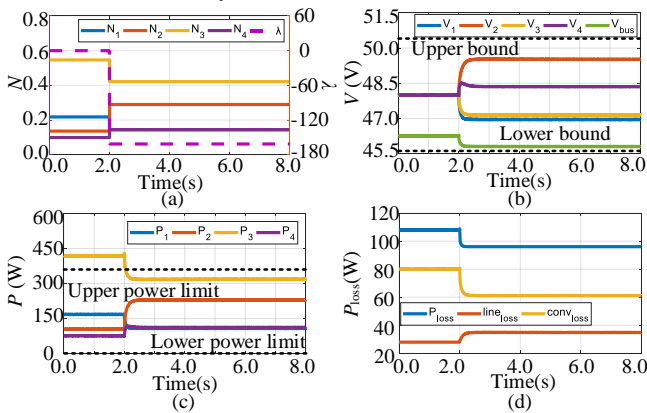


Fig. 9. Waveforms of the (a) current allocation coefficients and Lagrange multiplier, (b) output voltages of DER, (c) output power of DER, and (d) distribution power loss for the case 1.1.

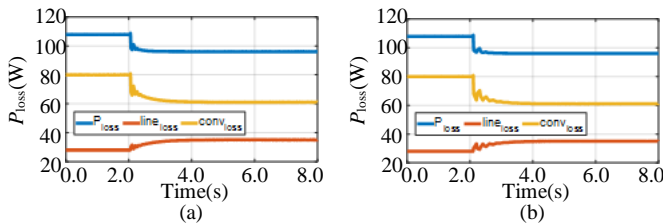


Fig. 10. Waveforms of the distribution power loss with communication delay of (a) 0.05s and (b) 0.1s for the case 1.1.

Similar to the case 1.1, the waveforms of current allocation coefficients, Lagrange multiplier, output voltages and power of the DER systems, bus voltage, and distribution power loss of the DC microgrid controlled by the conventional control strategy and the proposed control strategy for case 1.2 are presented in Fig. 11. However, the total output current of the DER systems is 12 A and the current sink is modelled to be -12 A. For case 1.2, the Lagrange multiplier of the proposed control strategy is calculated to be -94.72 and the corresponding current allocation coefficients are $N_1=0.1371$, $N_2=0.2926$, $N_3=0.427$, and $N_4=0.1433$, respectively. The corresponding output voltages and power of the DER systems are well-controlled within the boundaries. The comparisons of the distribution power loss between the two control strategies are exhibited in Fig. 11(d). The total distribution power loss is reduced by about 10.3% (from 67 W to 60.1 W) by the proposed control strategy.

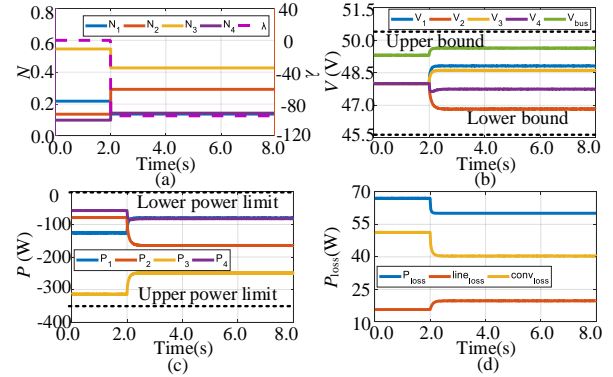


Fig. 11. Waveforms of the (a) current allocation coefficients and Lagrange multiplier, (b) output voltages of DER, (c) output power of DER, and (d) distribution power loss for the case 1.2.

In case 2, the conventional control strategy is adopted during the period from 0s to 2s, whereas the proposed control strategy without considering the output power constraint in (7.1) is adopted during the period from 2s to 6s and with the consideration of the output power constraint in (7.1) is used during the period from 6s to 10s. The total output current of the DER systems is 18 A and the current sink is modelled to be 18 A. The Lagrange multiplier is changed from 0 to -201.3 to -145. The corresponding current allocation coefficients of the proposed control strategy without the power constraint are $N_1=0.1463$, $N_2=0.2887$, $N_3=0.4196$, and $N_4=0.1455$, while the current allocation coefficients of the proposed control strategy with the power constraint are $N_1=0.1661$, $N_2=0.3222$, $N_3=0.3485$, and $N_4=0.1633$, as shown in Fig. 12(a). Although all the bus voltages are controlled within the limits, the output powers of DER3 controlled by the conventional control strategy and the proposed control strategy without considering the power constraint in (7.1) (i.e., 441.3 W and 349.9 W) are beyond the upper power limit (i.e., 350 W). But the output power of the DER3 controlled by the proposed control strategy with the constraint in (7.1) is clamped at the boundary of 350 W, as shown in Fig. 12(c). Therefore, both the conventional control strategy and the proposed control

strategy without considering the power constraint cannot meet the requirement. The proposed control strategy with the power constraint can reduce the distribution power loss by about 9.83% as compared to the conventional control strategy (i.e., from 132.2 W to 119.2 W).

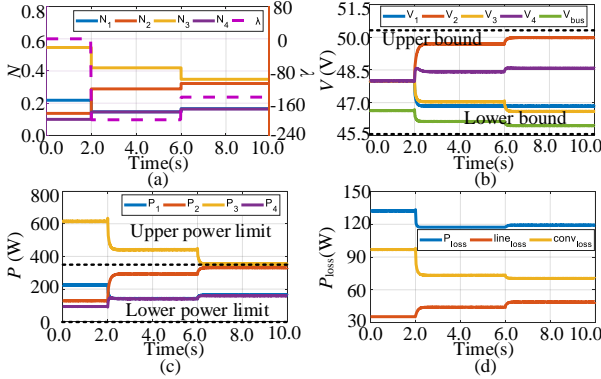


Fig. 12. Waveforms of the (a) current allocation coefficients and Lagrange multiplier, (b) output voltages of DER, (c) output power of DER, and (d) distribution power loss for the case 2.

In case 3, the four DER systems (i.e., DER1, DER2, DER3, and DER4) are connected to the DC bus during the period from 0s to 4s. At 4s, the DER4 is disconnected from the DC bus. Hence, three DER systems (i.e., DER1, DER2, and DER3) are connected to the DC bus during the period from 4s to 12s. At 12s, two additional DER systems (i.e., DER4 and DER5) are connected to the DC bus. Thus, five DER systems are connected to the DC bus during the period from 12s to 20s. The parameters of the DER5 are identical to those of the DER3. The total output current of the DER systems is 13 A and the current sink is modelled to be 13 A. The conventional control strategy is adopted during the periods from 0s to 2s, 8s to 12s, and 16s to 20s, while the proposed control strategy is applied during the periods from 2s to 4s, 4s to 8s, and 12s to 16s. The corresponding Lagrange multipliers of the proposed control strategy are -109.7, -228, and -88.6, respectively, as shown in Fig. 13(a). The output voltages and power of the DER systems are well-controlled within tolerances by the proposed control strategy, as shown in Fig. 13(b). The total distribution power loss are 78.3 W, 71.5 W, 78.8 W, 86.7 W, 61.4 W, and 68.2 W for each time period, as shown in Fig. 13(c). Compared to the conventional control strategy, the proposed control strategy can reduce the distribution power loss about 8.68% for the four DER systems, 9.11% for the three DER systems, and 9.97% for the five DER systems. The scalability of the proposed control strategy for different numbers of DER systems being plug-and-played in the DC microgrid is validated.

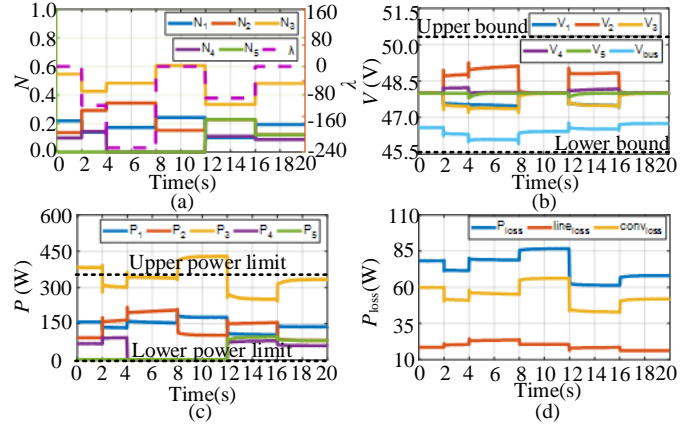


Fig. 13. Waveforms of the (a) current allocation coefficients and Lagrange multiplier, (b) output voltages of DER, (c) output power of DER, and (d) distribution power loss for the case 3.

In case 4, a non-dispatchable unit (i.e., a PV system) is connected to the DC microgrid with four DER systems. The daylong output currents of the non-dispatchable unit, DER systems, and load are plotted in Fig. 14. The variable output currents of the non-dispatchable unit and load are provided based on the measurements in practice [33], [34]. The current difference between the non-dispatchable unit and load are compensated by the total output current of the DER systems (i.e., I_{tol}). Fig. 15 show the waveforms of current allocation coefficients, Lagrange multiplier, output voltages and power of the DER systems, bus voltage, and distribution power loss of the DC microgrid being controlled by the conventional control strategy and the proposed control strategy. Obviously, the output voltages and power of the DER systems are controlled within the constraints. The comparisons of the total distribution power loss between the conventional control strategy and the proposed control strategy are presented in Fig. 15(d). The distribution power loss is reduced by the proposed control strategy. By accumulating the distribution power loss, the distribution energy loss of the DC microgrid with four DER systems in one day can be 2.058 kWh and 1.835 kWh by the conventional control strategy and proposed control strategy, respectively. The loss reduction by the proposed control strategy is about 10.84%.

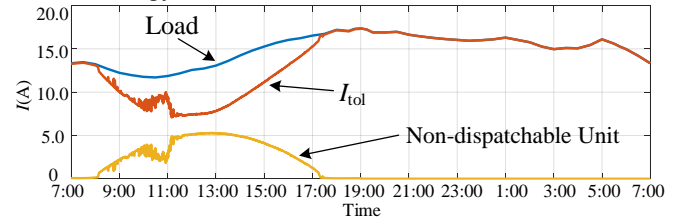


Fig. 14. Output currents of the non-dispatchable unit, DER systems, and load in case 4.

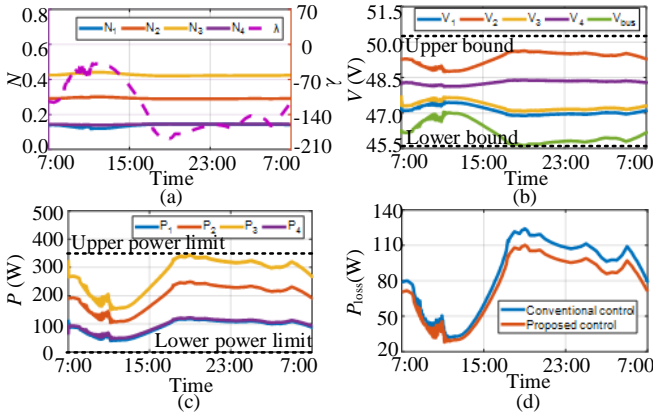


Fig. 15. Waveforms of the (a) current allocation coefficients and Lagrange multiplier, (b) output voltages of DER, (c) output power of DER, and (d) distribution power loss for the case 4.

V. EXPERIMENTAL VERIFICATIONS

Experiments are conducted on a 48 V DC microgrid with two/three DER systems being connected in parallel to the DC bus via non-isolated boost converters. The photograph of the test bench is presented in Fig. 16(a). The main parameters of the grid-connected boost converters are identical to the parameters provided in Table I. The rated voltages of the distributed generations are 38 V for all the DER systems. The current sink in the DC microgrid is implemented by the electronic load PLA5K-800-100E. The constraints of the output voltages of the DER systems are the same as the constraints in Table I, whereas the lower and upper bounds of the output power and source currents of the DER systems are 0 W, 212 W, 0 A, and 10 A, respectively. The switching frequency of the grid-connected boost converters is 100 kHz. The communication delay is about 0.01s. The line resistances, current sink, and tuning parameters of the proposed control strategy in different scenarios are provided in Table IV. The droop coefficient (i.e., R_{di}) and tuning coefficients of the controllers (i.e., K_{P_i} , K_{I_i} , $K_{P_{1i}}$, $K_{I_{1i}}$, $K_{P_{2i}}$, and $K_{I_{2i}}$) are identical for all the DER. The line resistances of the DER systems are changed by adding high-current chassis amount resistors (i.e., TGH1V1R00JE, TGH1V500JE, and TGH1V100JE) to validate the effectiveness of the proposed control strategy in different scenarios. The digital signal processor (DSP) Delfino TMS320F28379D from Texas Instrument is adopted as the controllers for the DER systems. The conversion loss coefficients of are determined based on the input and output voltages and currents of the DER systems. The converter loss curves of the three grid-connected boost converters are plotted in Fig. 16(b). Apparently, the converter loss are quadratic functions of the output currents of the DER systems. The conversion loss coefficients of the DER1, DER2 and DER3 are $a_1 = 1.161$, $b_1 = 0.730$, $c_1 = 1.693$, $a_2 = 0.641$, $b_2 = 0.547$, $c_2 = 5.260$, $a_3 = 1.693$, $b_3 = 5.26$, and $c_3 = 3.54$, respectively. In Scenarios 1 and 2, only DER1 and DER2 systems are adopted. In Scenario 3, all the three DER systems are penetrated.

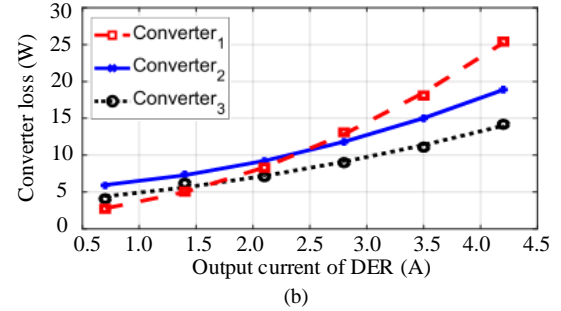
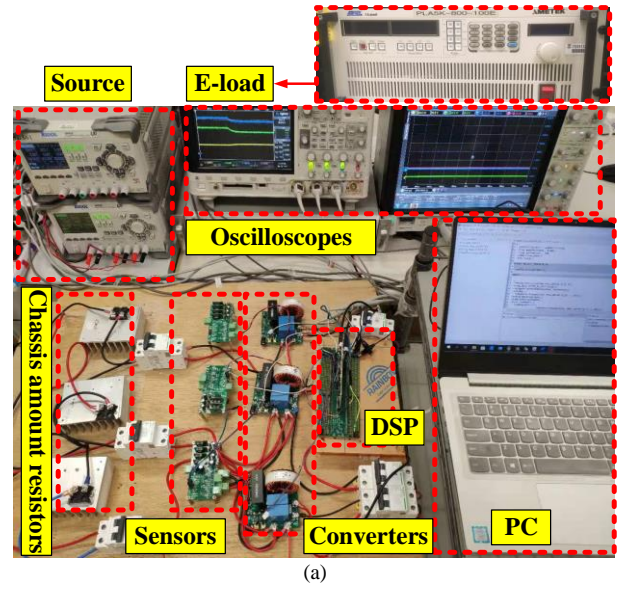


Fig. 16. (a) Test bench and (b) converter loss versus output currents of the DER systems in experiment.

TABLE IV. DETAILS OF THE THREE SCENARIOS IN EXPERIMENT

Scenario	Line resistances and current sink				Controller parameters						
	$R_1(\Omega)$	$R_2(\Omega)$	$R_3(\Omega)$	$I_{tot}(A)$	$R_{di}(\Omega)$	K_{P_i}	K_{I_i}	$K_{P_{1i}}$	$K_{I_{1i}}$	$K_{P_{2i}}$	$K_{I_{2i}}$
1	0.53	2.53	—	4.75	0.05	0.02	0.4	0.025	0.2	0.05	0.1
2	0.1	0.1	—	6.9	0.05	0.02	0.4	0.025	0.2	0.05	0.1
3	0.53	2.53	1.26	4.75	0.05	0.02	0.4	0.025	0.2	0.05	0.1

A. Scenario I

In scenario I, the conventional control strategy and the proposed control strategy are adopted during the period from 0s to 2s and from 2s to 5s, respectively. The total output current is 4.75 A (i.e., $I_{tot}=4.75$ A). Fig. 17 shows the waveforms of current allocation coefficients, Lagrange multiplier, output voltages and currents of the DER systems, output power of the first DER system, and distribution power loss of the DC microgrid. Here, the output voltages and currents are directly measured by the probes. The output power is calculated and plotted using the oscilloscope DSO-X-3034A from the Agilent Technologies. The current allocation coefficients, Lagrange multiplier, distribution power loss, line loss, and converter loss are output via the digital-to-analog (DAC) pins of the DSP. When the proposed control strategy is adopted at the 2s, the Lagrange multiplier is calculated to be -47.73 and the corresponding current allocation coefficients are 0.648 and 0.352, respectively, as shown in Fig. 17(a). Based

on the total output current and the current allocation coefficients, the output current references of the two DER systems can be calculated as 3.078 A and 1.672 A, respectively. The measured output currents of the DER systems are 3.08 A and 1.67 A, as shown in Fig. 17(b). Obviously, the output currents of the DER systems are well-regulated by the adaptive droop control to track the references. The output voltages of the DER systems being controlled by the proposed control strategy are 48.5 V and 47.8 V. Both the output voltages are controlled within the tolerances. The output powers of the DER systems being controlled by the proposed control strategy are 147.9 W and 81 W (only the output power of DER1 is shown in Fig. 17(b)). Apparently, the output powers are also controlled within the limits. The distribution power loss for the two control strategies are 38.53 W and 35.03 W, respectively.

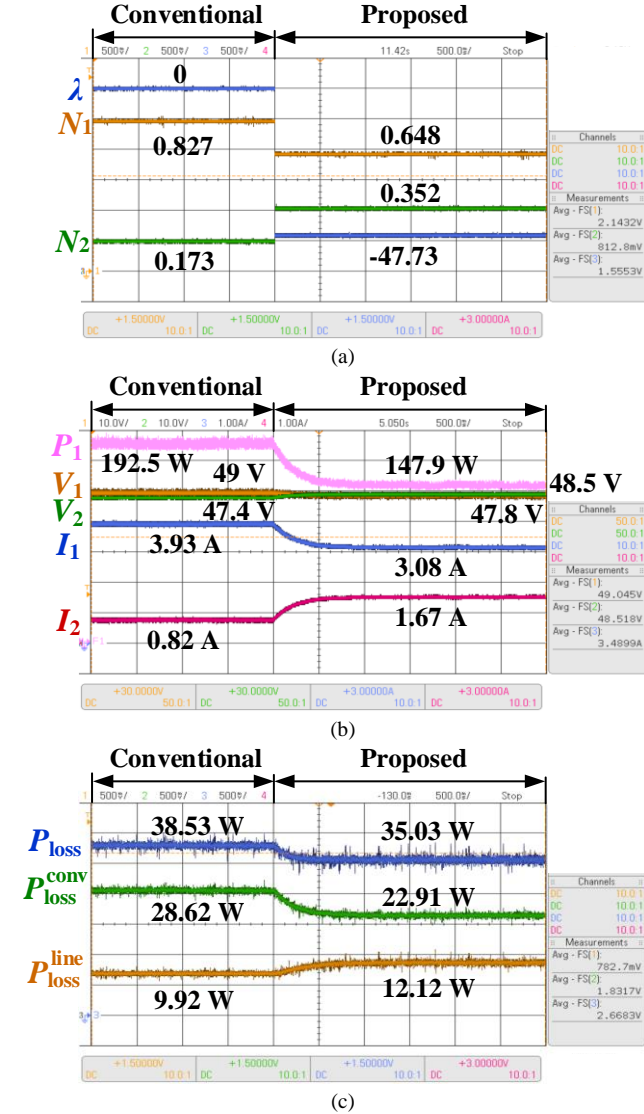
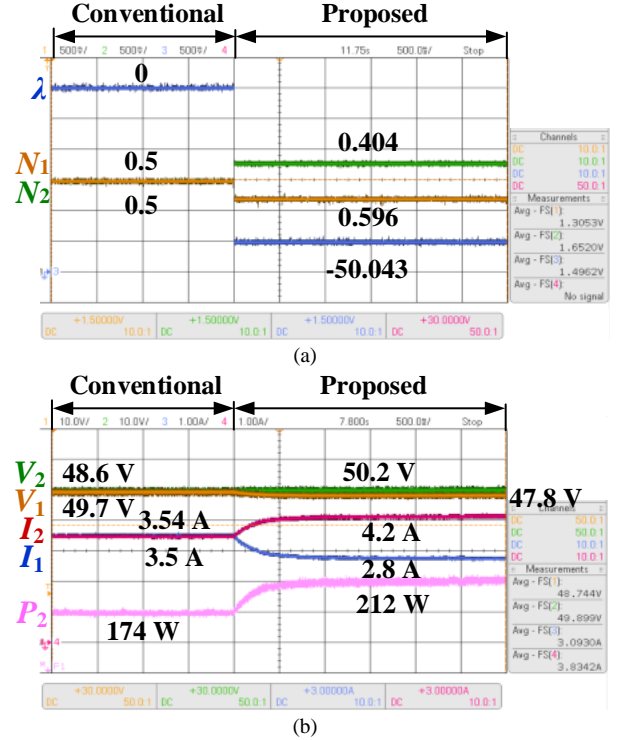


Fig. 17. Waveforms of the (a) current allocation coefficients and Lagrange multiplier, (b) output voltages, currents and power of DER systems, and (c) distribution power loss of the DC microgrid for the scenario I.

B. Scenario II

In scenario II, the conventional control strategy and the proposed control strategy are adopted during the period from 0s to 2s and from 2s to 5s, respectively. The total output current is 7.0 A (i.e., $I_{tot}=7.0$ A). The waveforms of the current allocation coefficients, Lagrange multiplier, output voltages and currents of the DER systems, output power of the first DER system, and distribution power loss of the DC microgrid, are shown in Fig. 18. The Lagrange multiplier is -50.043 and the corresponding current allocation coefficients are 0.404 and 0.596, respectively, as shown in Fig. 18(a). Then, the output current references of the two DER systems can be calculated to be 2.788 A and 4.212 A, respectively. The measured output currents of the DER systems are 2.8 A and 4.2 A, as shown in Fig. 19(b). Apparently, the errors between the output current references and the measured output currents are quite small. The output voltages of the DER systems controlled by the proposed control strategy, i.e., 47.8 V and 50.2 V, are within the tolerances. The output power of the DER systems controlled by the proposed control strategy are 134 W and 212 W (only the output power of DER2 is shown in Fig. 17(b)). Obviously, the output power of DER2 is clamped at the boundary of 212 W. The distribution power loss of the microgrid controlled by the conventional control strategy and the proposed control strategy are 35.95 W and 33.83 W, respectively.



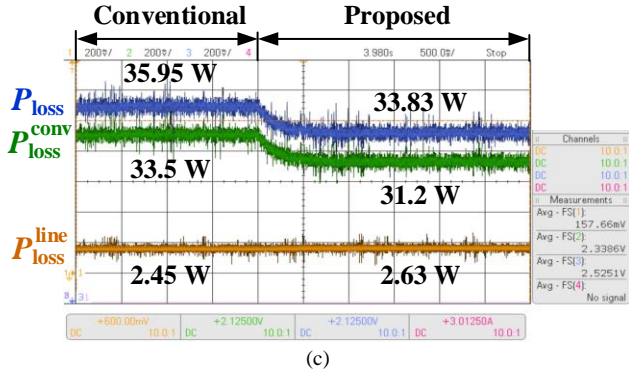


Fig. 18. Waveforms of the (a) current allocation coefficients and Lagrange multiplier, (b) output voltages, currents and power of DER systems, and (c) distribution power loss of the DC microgrid for the scenario II.

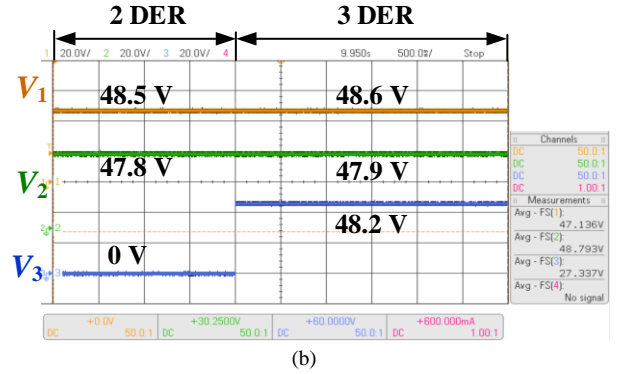


Fig. 19. Waveforms of the (a) output currents and (b) output voltages of the DER systems when the third DER is connected.

C. Scenario III

Scenario III is set up based on scenario I by connecting the DER3 into the DC microgrid. The controller parameters of the newly connected DER system are identical to the controller parameters of the other two DER systems. Fig. 19 shows the waveforms of the output currents and voltages of the DER systems controlled by the proposed control strategy when the third DER system is connected. The output currents are re-allocated to a new steady state, while the total output current remains at 4.75 A (i.e., $I_{tot}=4.75$ A). The output voltages of the three DER are 48.6 V, 47.9 V, and 48.2 V, respectively. All the output voltages are controlled within the tolerances. Then, the conventional control strategy is adopted for the three DER systems for comparisons. Fig. 20 show the waveforms of current allocation coefficients and distribution power loss. The current allocation coefficients of the proposed control are 0.3918, 0.2148, and 0.3934 during the period from 0s to 2s, while the current allocation coefficients of the conventional control are 0.6127, 0.1285, and 0.2587 during the period from 2s to 5s. The distribution power loss of the proposed control and the conventional control are 29.07 W and 32.14 W, respectively.

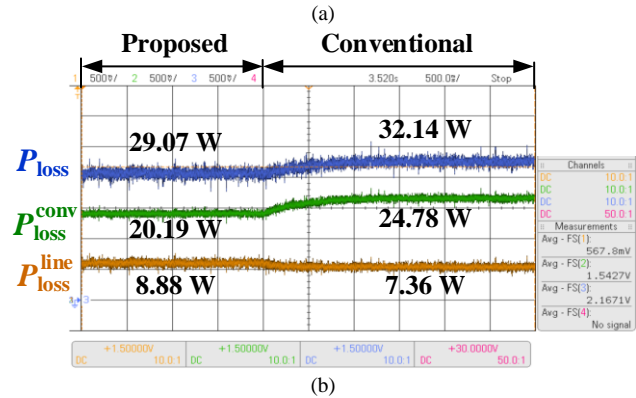
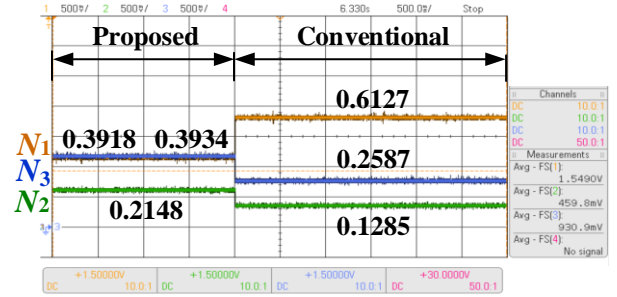
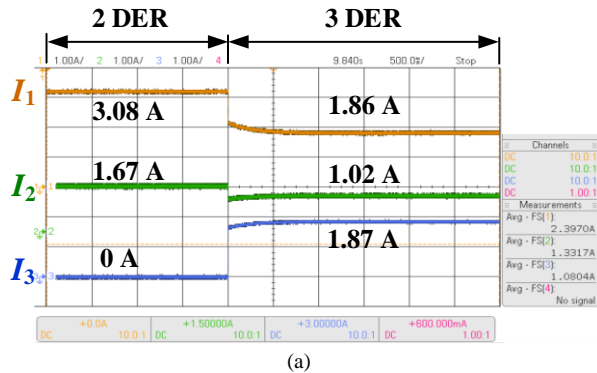


Fig. 20. Waveforms of the (a) current allocation coefficients and (b) distribution power loss of the three DER systems for the scenario III.

The comparisons of the distribution power loss between the proposed control strategy and the conventional control strategy in three experimental scenarios are given in Table V. The proposed control strategy can save about 9.08%, 5.9%, and 9.55% loss reduction, as compared to the conventional control strategy in scenarios I, II, and III, respectively.

TABLE V. DETAILS OF THE THREE SCENARIOS IN EXPERIMENT

Scenario	Conventional	Proposed	Loss reduction (%)
	P_{loss} (W)	P_{loss} (W)	
1	38.53	35.03	9.08
2	35.95	33.83	5.9
3	32.14	29.07	9.55

VI. CONCLUSIONS

This paper presents a Lagrange multiplier-based adaptive droop control to mitigate distribution power loss of parallel-connected distributed energy resources (DER) in DC

microgrids. Unlike previous studies which consider only line loss, the proposed control strategy considers both the line loss and the converter loss. The effectiveness of the proposed three-layer hierarchical control to reduce the distribution power loss is validated by both simulation and experimental results. The three-layer control has been implemented and demonstrated successfully in hardware setups. Practical tests have confirmed that the distribution power loss of the parallel-connected DER systems in a 48 V DC microgrid can be reduced by about 9.08%, 5.9%, and 9.55%, as compared to the conventional control strategy in three scenarios.

APPENDIX

Theorem 1: For positive real variables $x_i > 0$ ($\exists x_i \neq 0$), if they

$$\text{satisfy } \left[\sum_{i=1}^n (x_i - x_1) \quad \sum_{i=1}^n (x_i - x_2) \quad \cdots \quad \sum_{i=1}^n (x_i - x_n) \right]^T = \mathbf{0}, \text{ all}$$

these variables are equal as $x_1 = x_2 = \cdots = x_n$.

Proof:

By rearranging the condition in the **Theorem 1**,

$$\begin{bmatrix} (1-n)x_1 + x_2 + \cdots + x_n \\ x_1 + (1-n)x_2 + \cdots + x_n \\ \vdots \\ x_1 + x_2 + \cdots + (1-n)x_n \end{bmatrix} = \begin{bmatrix} 0 \\ 0 \\ \vdots \\ 0 \end{bmatrix} \quad (\text{A1})$$

which can be further simplified as

$$\begin{bmatrix} \sum_{i=1}^n x_i \\ \sum_{i=1}^n x_i \\ \vdots \\ \sum_{i=1}^n x_i \end{bmatrix} = \begin{bmatrix} nx_1 \\ nx_2 \\ \vdots \\ nx_n \end{bmatrix} \quad (\text{A2})$$

By solving (A2), all the variables are equal to each other.


REFERENCES

- [1] D. J. Becker and B. J. Sonnenberg, "DC microgrids in buildings and data centers," In *2011 IEEE 33rd International Telecommunications Energy Conference (INTELEC)*, Amsterdam, Netherlands, Oct. 2011, pp. 1-7.
- [2] L. Meng, T. Dragičević, J. C. Vasquez, and J. M. Guerrero, "Tertiary and secondary control levels for efficiency optimization and system damping in droop controlled DC-DC converters," *IEEE Trans. Smart Grid*, vol. 6, no. 6, pp. 2615-2626, Jun. 2015.
- [3] M. K. Zadeh, R. Gavagsaz-Ghoachani, S. Pierfederici, B. Nahid-Mobarakeh, and M. Molinas, "Stability analysis and dynamic performance evaluation of a power electronics-based DC distribution system with active stabilizer," *IEEE J. Emerg. Sel. Topics Power Electron.*, vol. 4, no. 1, pp. 93-102, Mar. 2016.
- [4] J. Ma, F. He, and Z. Zhao, "Line loss optimization based OPF strategy by hierarchical control for DC microgrid," in *Proc. 2015 IEEE Energy Conversion Congress & Expo. (ECCE)*, Montreal, Canada, Sept. 2015, pp. 6212-6212.
- [5] Y. Jiang, Y. Yang, S. C. Tan, and S. Y. R. Hui, "Adaptive current sharing of distributed battery systems in DC microgrids using adaptive virtual resistance-based droop control," in *Proc. 2019 IEEE Energy Conversion Congress & Expo. (ECCE)*, Baltimore, USA, Sept. 2019, pp. 4262-4267.
- [6] K. Natori, T. Tanaka, Y. Takahashi, and Y. Sato, "A study on high-efficiency floating multi-terminal power flow controller for next generation DC power networks," in *Proc. 2017 IEEE Energy Conversion Congress & Expo. (ECCE)*, Cincinnati, USA, Oct. 2017, pp. 2631-2637.
- [7] E. Candan, P.S. Shenoy, and R.C. Pilawa-Podgurski, "A series-stacked power delivery architecture with isolated differential power conversion for data centers," *IEEE Trans. Power Electron.*, vol. 31, no. 5, pp. 3690-3703, May 2016.
- [8] M. Farasat and A. Arabali, "Voltage and power control for minimising converter and distribution losses in autonomous microgrids," *IET Gener., Transm. Distrib.*, vol. 9, no. 13, pp. 1614-1620, Oct. 2015.
- [9] M. Hussain, "Optimal placement of distributed energy resources in a DC microgrid with constant power loads to minimize bus voltage deviations and line losses," in *Global Power, Energy and Communication Conference*, Cappadocia, Turkey, Jun. 2019, pp. 424-429.
- [10] A. Garcés, "On the convergence of Newton's method in power flow studies for DC microgrids," *IEEE Trans. Power Syst.*, vol. 33, no. 5, pp. 5770-5777, Dec. 2018.
- [11] D. Zhang, L. Wang, J. Jiang, and W. Zhang, "Optimal power management in DC microgrids with applications to dual-source trolleybus systems," *IEEE Trans. Intell. Transp. Syst.*, vol. 19, no. 4, pp. 1188-1197, Apr. 2018.
- [12] K. Rouzbehi, J. I. Candela, A. Luna, G. B. Gharehpetian, and P. Rodriguez, "Flexible control of power flow in multiterminal dc grids using dc-dc converter," *IEEE J. Emerg. Sel. Topics Power Electron.*, vol. 4, no. 3, pp. 1135-1144, Sept. 2016.
- [13] T. Hong and F. de Leon, "Centralized unbalanced dispatch of smart distribution dc microgrid," *IEEE Trans. Smart Grid*, vol. 9, no. 4, pp. 2852-2861, Jul. 2018.
- [14] Y. Yang, S. C. Tan, and S. Y. R. Hui, "Mitigating distribution power loss of DC microgrids with DC electric springs," *IEEE Trans. Smart Grid*, vol. 9, no. 6, pp. 5897-5906, Nov. 2018.
- [15] J. Deng, Y. Mao, and Y. Yang, "Distribution power loss reduction of standalone DC microgrids using adaptive differential evolution-based control for distributed battery systems," *Energies*, vol. 13, no. 9, pp. 2129, Jan. 2020.
- [16] W. Su, S. Yun, H. Li, et. al., "An MPC-based dual-solver optimization method for DC microgrids with simultaneous consideration of operation cost and power loss," *IEEE Trans. Power Syst.*, Jul. 2020 (early access).
- [17] H. Su, C. Deng, F. Guo, X. Chen, and C. Qi, "Distributed load sharing and transmission power loss optimisation for DC microgrids," *IET Control Theory*, vol. 13, no. 17, pp. 2930-2939, Apr. 2019.
- [18] J. Beerten, S. Cole, and R. Belmans, "Generalized steady-state VSC MTDC model for sequential AC/DC power flow algorithms," *IEEE Trans. Power Syst.*, vol. 27, no. 2, pp. 821-829, May 2012.
- [19] J. Cao, W. Du, H. F. Wang, and S. Q. Bu, "Minimization of transmission loss in meshed AC/DC grids with VSC-MTDC networks," *IEEE Trans. Power Syst.*, vol. 28, no. 3, pp. 3047-3055, Aug. 2013.
- [20] J. H. Teng, S.-H. Liao, W.-H. Huang, and C. C. Chiang, "Smart control strategy for conversion efficiency enhancement of parallel inverters at light loads," *IEEE Trans. Ind. Electron.*, vol. 63, no. 12, pp. 7586-7596, Dec. 2016.
- [21] W. Yuan, Y. Wang, D. Liu, F. Deng, and Z. Chen, "Efficiency-Prioritized Droop Control Strategy of AC Microgrid," *IEEE J. of Emerg. Sel. Topics Power Electron.*, Jan. 2020 (early access).
- [22] J. Ma, L. Yuan, Z. Zhao, and F. He, "Transmission loss optimization-based optimal power flow strategy by hierarchical control for DC microgrids," *IEEE Trans. Power Electron.*, vol. 32, no. 3, pp. 1952-1963, Mar. 2017.
- [23] J. Ma, Y. Li, M. Zhu, and X. Cai, "Parallel operation of distributed voltage balancers for bipolar DC system with improved reliability and efficiency," in *43rd Annual Conference of the IEEE Industrial Electronics Society (IECON 2017)*, Beijing, China, Oct. 2017, pp. 1387-1392.
- [24] S. Boyd and L. Vandenberghe, *Convex Optimization*. Cambridge, U.K.: Cambridge Univ. Press, 2004.
- [25] S. Mudaliyar, and S. Mishra, "Coordinated voltage control of a grid connected ring DC microgrid with energy hub," *IEEE Trans. Smart Grid*, vol. 10, no. 2, pp. 1939-1948, Mar. 2019.
- [26] H. Wang, A. M. Khambadkone, and X. Yu, "Control of parallel connected power converters for low voltage microgrid-Part II: dynamic

- electrothermal modeling," *IEEE Trans. Power Electron.*, vol. 25, no. 12, pp. 2971-2980, Dec. 2010.
- [27] TDHBG2500P100: 2.5kW Half-bridge Evaluation Board User Guide, Transphorm, <https://www.transphormusa.com/en/document/tdhbg2500p100-user-guide/>.
- [28] J. Zhou, M. Shi, Y. Chen, et. al., "A novel secondary optimal control for multiple battery energy storages in a dc microgrid," *IEEE Tran. Smart Grid*, Jul. 2020 (early access).
- [29] M. Shi, X. Chen, J. Zhou, et. al., "Distributed optimal control of energy storages in a DC microgrid with communication delay," *IEEE Trans. Smart Grid*, vol. 11, no. 3, pp. 2033-2042, May 2020.
- [30] S. Sahoo and S. Mishra, "A distributed finite-time secondary average voltage regulation and current sharing controller for DC microgrids," *IEEE Trans. Smart Grid*, vol. 10, no. 1, pp.282-292, Jan. 2019.
- [31] M. Shi, X. Chen, J. Zhou, et. al., "Advanced secondary voltage recovery control for multiple HESSs in a droop-controlled DC microgrid," *IEEE Trans. Smart Grid*, vol. 10, no. 4, pp. 3828-3839, Jul. 2019.
- [32] Q. Xu, J. Xiao, X. Hu, et.al., "A decentralized power management strategy for hybrid energy storage system with autonomous bus voltage restoration and state-of-charge recovery," *IEEE Trans. Ind. Electron.*, vol. 64, no. 9, pp.7098-7108, Sept. 2017.
- [33] Y. Yang, Y. Qin, S. C. Tan, and S. Y. R. Hui, "Efficient improvement of photovoltaic-battery systems in standalone DC microgrids using a local hierarchical control for the battery system," *IEEE Trans. Power Electron.*, vol. 34, no. 11, pp. 10796-10807, Nov. 2019.
- [34] RTE France, "Daily load curves," <https://www.services-rte.com/en/view-data-published-by-rte/daily-load-curves.html>.



Yajie Jiang received the B.Eng. degree from the School of Electrical Engineering, Zhengzhou University, Zhengzhou, China in 2015 and the M.Eng. degree in the School of Electrical and Electronic Engineering, Huazhong University of Science and Technology, Wuhan, China in 2018. He is currently pursuing the Ph.D. degree in the Department of Electrical and Electronic Engineering, the University of Hong Kong. His research interests include smart grid and machine drive.



Yun Yang (M'17) received his B.Sc. degree in Electrical Engineering from Wuhan University in 2012 and Ph.D. degree in Electrical Engineering from The University of Hong Kong in 2017. He then became a Postdoctoral-Fellow in the same research group. Now, he is a Research Assistant Professor in the Department of Electrical Engineering, the Hong Kong Polytechnic University and an Honorary Research Assistant Professor in the Department of Electrical and Electronic Engineering, the University

of Hong Kong.

He has authored or coauthored more than 40 technical papers, including 10 leading journals published as the first author. He also has two book chapters and two U.S. patent applications. His research interests include wireless power transfer, microgrid, power electronics and control.



Siew-Chong Tan (M'06-SM'11) received the B.Eng. (Hons.) and M.Eng. degrees in electrical and computer engineering from the National University of Singapore, Singapore, in 2000 and 2002, respectively, and the Ph.D. degree in electronic and information engineering from the Hong Kong Polytechnic University, Hong Kong, in 2005. He is currently a Professor in Department of Electrical and Electronic Engineering, The University of Hong Kong, Hong Kong. Prof. Tan was a Visiting Scholar at Grainger Center for Electric

Machinery and Electromechanics, University of Illinois at Urbana-Champaign, Champaign, from September to October 2009, and an Invited Academic Visitor of Huazhong University of Science and Technology, Wuhan, China, in December 2011. His research interests are focused in the areas of power electronics and control, LED lightings, smart grids, and clean energy technologies.



S. Y. (Ron) Hui (M'87-SM'94-F'03) received his BSc (Eng) Hons in Electrical and Electronic Engineering at the University of Birmingham in 1984 and a D.I.C. and PhD in Electrical Engineering at Imperial College London in 1987. Presently, he holds the Philip Wong Wilson Wong Chair Professorship at the University of Hong Kong and a Chair Professorship at Imperial College London.

He has published over 450 research papers including 280 refereed journal publications. Over 60 of his patents have been adopted by industry. His research interests include power electronics, wireless power, sustainable lighting and smart grid. His inventions on wireless charging platform technology underpin key dimensions of Qi, the world's first wireless power standard, with freedom of positioning and localized charging features for wireless charging of consumer electronics. He also developed the Photo-Electro-Thermal Theory for LED Systems. He received the IEEE Rudolf Chope R&D Award and the IET Achievement Medal (The Crompton Medal) in 2010 and IEEE William E. Newell Power Electronics Award in 2015. He is a Fellow of the Australian Academy of Technological Sciences & Engineering, US National Academy of Inventors and Royal Academy of Engineering, U.K.